

HORIZONTAL JOINT
REINFORCEMENT W/ EYE &
PINTLE WALL TIES @
16" O.C.

BRICK VENEER

TERMINATION BAR

CMU

AIR SPACE

AIR / MOISTURE / VAPOR
BARRIER (A/M/V) - AS REQUIRED

MORTAR DROPPING
COLLECTION DEVICE (MDCD)

INSULATION

FLASHING
(SEAL TO DRIP EDGE)

WEEP VENT INSERTS

DRIP EDGE (SEAL)
SEAL DRIP TO BRICK


GRADE / LOOSE FILL
SEAL BRICK OPTION

GROUT FILL

INSULATION

A/M/V
(AS REQUIRED)

SCALE: 3" = 1'-0"

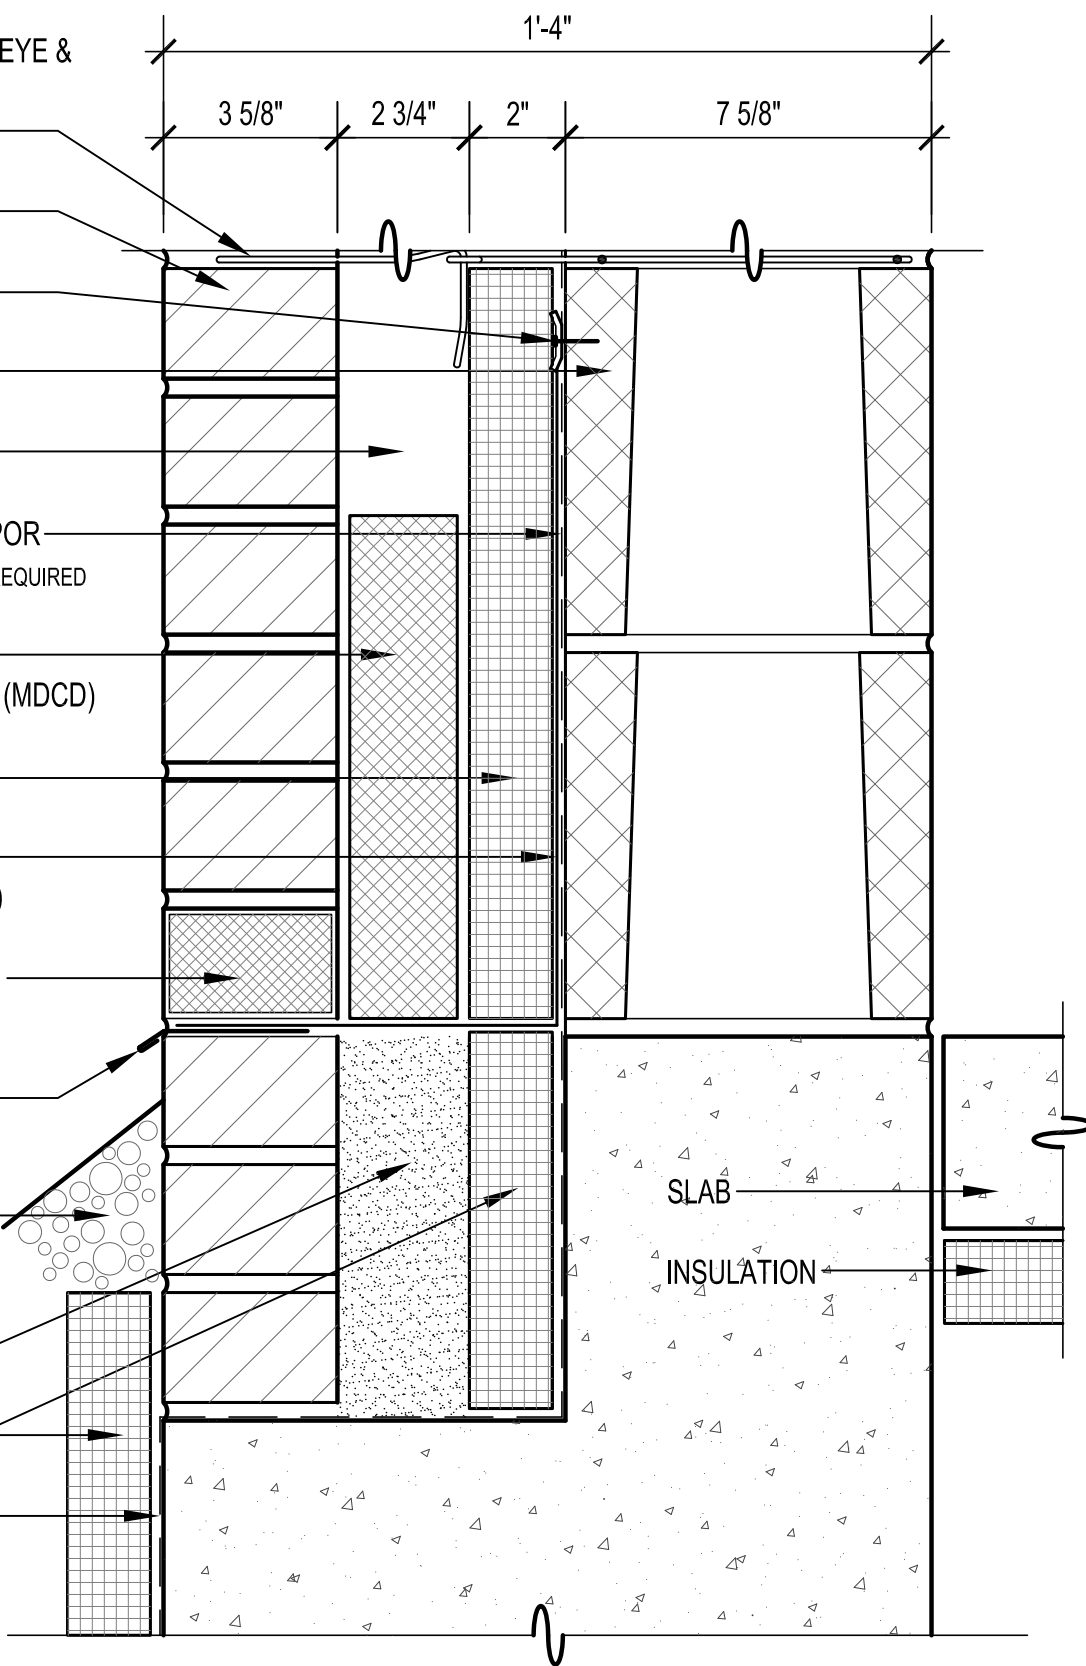

BASE OF WALL DETAIL

BRICK LEDGE, FOUND. BELOW GRADE

DETAIL 01.030.0322.2D

REV. 10/05/09

International Masonry Institute

team MASONRY
DETAILING
SERIES

800-IMI-0988 www.imiweb.org

© 2009 International Masonry Institute