


KEY NOTES

- 02 Concrete masonry backup
- 03 Stone veneer
- 04 Stone sill
- 31 Horizontal joint reinforcement
- 32 Wall tie
- Air space: 2" recommended, 1" min. req'd by code
- 36 Reinforcement per structural design
- 41 Cavity insulation
- 51 Flashing
- 53 End dam
- 61 Air/moisture/vapor barrier as req'd
- 72 Vertical expansion joint

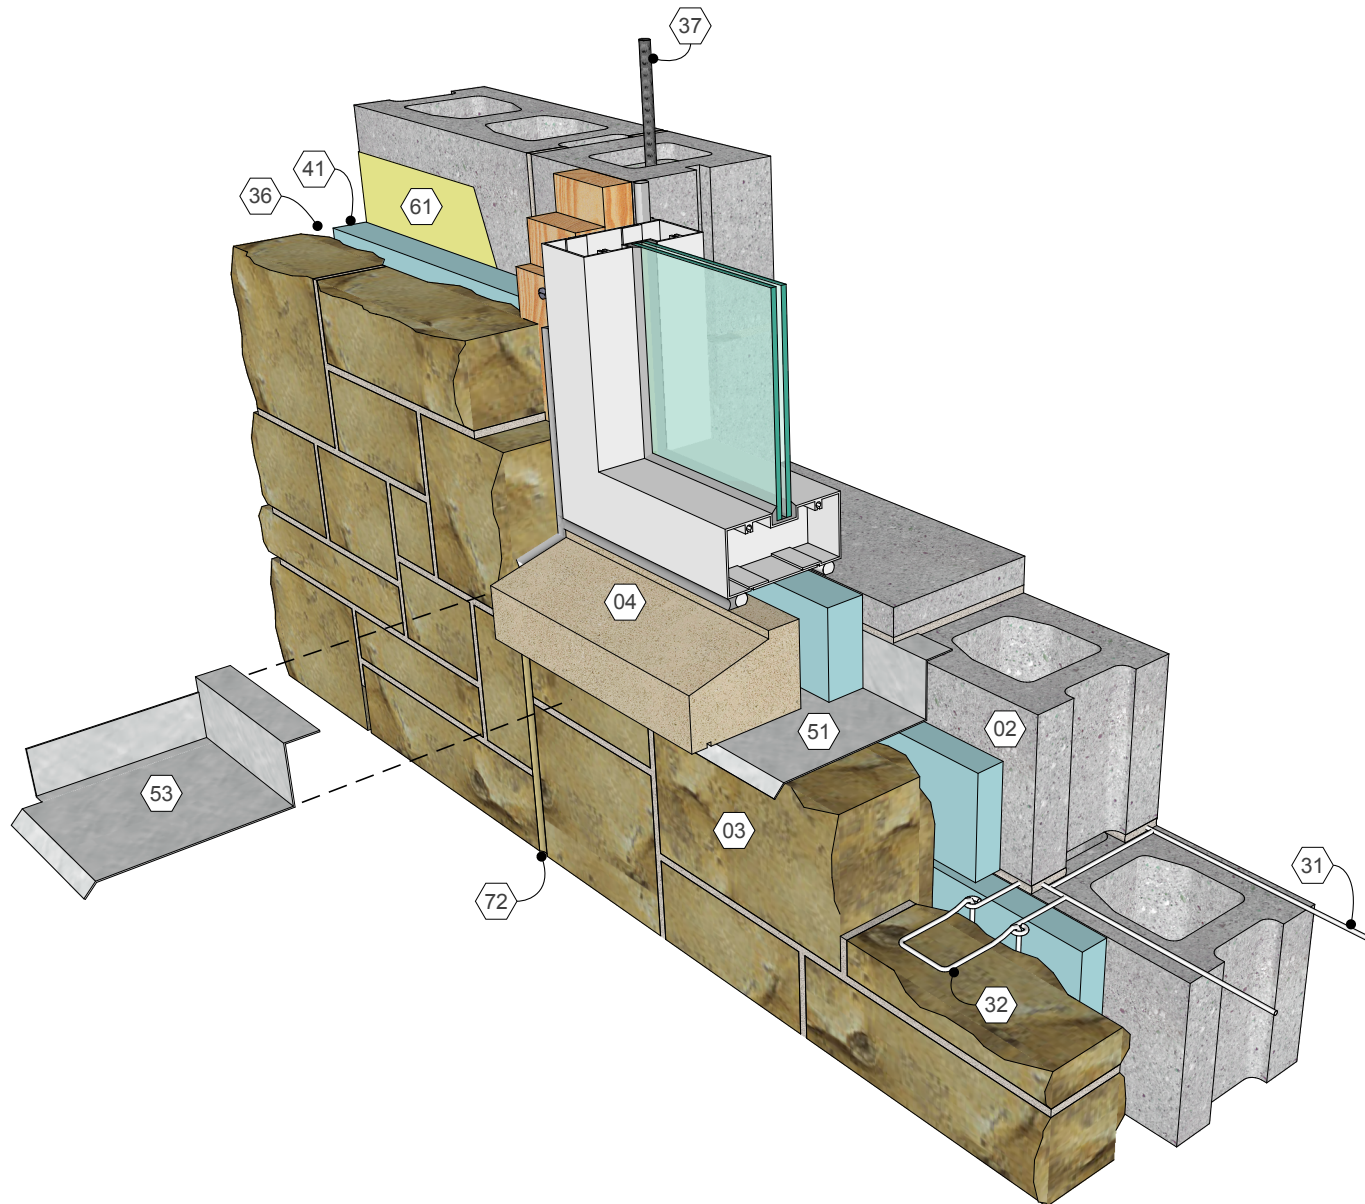

WINDOW SILL
Detail 03.030.0401

Anchored stone veneer
9/8/16

KEY WORDS

Sill, Veneer, Stone, Flashing,
Drainage, High-performing,
03.030.0401

International Masonry Institute



800-IMI-0988

www.imiweb.org

© 2016 International Masonry Institute